#### Istituto Giordano S.p.A.



Via Rossini, 2 - 478 | 4 Bellaria-Igea Marina (RN) - İtalia
Tel. +39 054 | 343030 - Fax +39 054 | 345540
istitutogiordano@giordano.it - www.giordano.it
PEC: ist-giordano@legalmail.it
Cod. Fisc/Part. IVA: 00 549 540 409 - Cap. Soc. € I.500.000 i.v.
RE.A. c/o C.C.I.A.A. (RN) 156766
Registro Imprese di Rimini n. 00 549 540 409

## **TEST REPORT No. 319105**

Place and date of issue: Bellaria-Igea Marina - Italia, 30/09/2014

Customer: VIOMETALOUMIN BOUTSINIS J. - BAFALOUKAS J. G.P. - Thesi Patima Aspropyrgos -

19300 ATHENS - Greece

Date testing request: 11/07/2014

Order number and date: 63738, 14/07/2014

Date sample received: 27/08/2012

Date of testing: from 05/08/2014 to 06/08/2014

Purpose of testing: Burglar resistance and classification (resistance under static load, resistance

under dynamic loading and resistance to manual burglary attempts) according to standards UNI EN 1627:2011, UNI EN 1628:2011, UNI EN 1629:2011 and UNI

EN 1630:2011 of folding grill

Place of testing: Istituto Giordano S.p.A. - Via Erbosa, 72 - 47043 Gatteo (FC) - Italia

Origin of sample: sampled and supplied by the Customer

Identification of sample received: no. 2014/1574

#### Name of sample\*

The sample under test is named "T 120 - 1350×2350".

#### Description of sample\*





(\*) according to that stated by the Customer.

LAB N° 0021

(\*) according to the technical documentation supplied by the Customer and on the basis of checks carried out by staff from Istituto

Giordano \$.p.A.. Comp. MB Revis. RP

This test report is made up of 17 sheets.

Sheet 1 of 17







The sample under test consists of a single leaf folding grill, featured as listed in the following table.

Sample total nominal width	1350 mm
Sample total nominal height	2350 mm
Sample usable width	910 mm
Sample usable height	2060 mm

The folding door type 120 consists of columns aluminum reinforced interior with bars of iron. The columns linked together with inox 316 shears. The door pulled into the upper and lower guide with bearings that are at the bottom of the door. The profile lock has a security lock to which may be locked either in or out as also being locked only from the inside without being seen from the outside of the lock. The folding door can only be pulled or rotate. When the door rotates four profiles of the hinge is designed in such a way as to achieve the 180° rotation of the door while providing protection. The folding door movement to the one side (single leaf door).

Further details of sample specifications can be seen in the Customer-supplied list of components and schematic drawings set out hereafter.

Finally, the sample has a surrounding steel frame used to hold the test installation securely in place.

#### Customer-supplied list of components.

Code	Description	Quantity
17.22	apostate	1
17.23	locking blade	2
17.24	folding shear	80
17.25	support plate	2
17.26	clamp restraint	1
17.27	plastic to centre the lock	1
17.28	plastic rotary joint	2
17.29	hinge A profile	1
17.30	hinge B profile	1
17.31	reinforced beam profile	9
17.32	reinforced beam hng profile 1	
17.33	frame hinge profile 1	
17.34	reinforced beam lock profile	1







Code	Description	Quantity
17.35	cover frame profile	2
17.36	frame lock profile	1
17.37	guide profile	3
17.40	receptor distance spacer guide	0
17.43	receptor stop guide (double d.)	0
17.44	pin guide / stop guide (double d.)	0
17.45	spacer ring	0
17.49	distance spacer guide	0
17.50	stop guide (down) - (double d.)	0
17.53	regulator hinge	1
17.54	pin regulator hinge	1
17.55	metal plug hinge (down)	1
17.56	metal plug hinge (up)	1
17.71	pin lock	5
17.74	pin Ø6×37	47
17.75	pin Ø6×23,8	44
17.76	pin Ø6×9	36
17.77	plastic plug lock (under / down)	2
17.78	socket screw	6
17.79	plastic guide (pin hinge)	2
17.80	sheet met. flush screw 5,3×32 +	2
17.81	sheet met. raish screw 5,3×32 +	2
17.82	lock	1
17.83	inox spacer ring 6×9,5	1
17.84	plastic closure plug	44
17.85	plastic guide (folding shear)	160
17.86	plastic plug (under / down)	36
17.87	plastic plug holder (guide) 2	
17.88	rivet iron 4×12	
17.89	sheet metal flush screw 8×5/8 10	
17.90	wood flush screw 6×80	0
17.91	upat 8×80	0









Code	Description	Quantity
17.92	rivet al 5×16	3
17.93	rivet 5×8	2
17.94	bearing	3
17.95	washer aluminium	3
17.96	metal screw 5,3×20	20

## **SAMPLE ELEVATIONS**

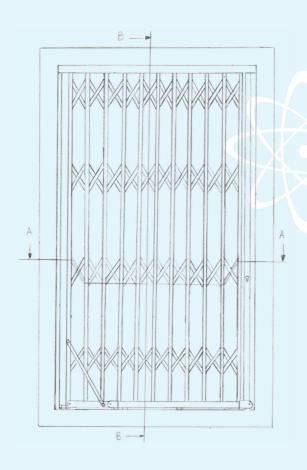

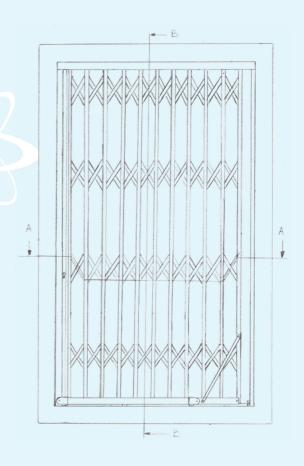








## **HORIZONTAL SECTION**

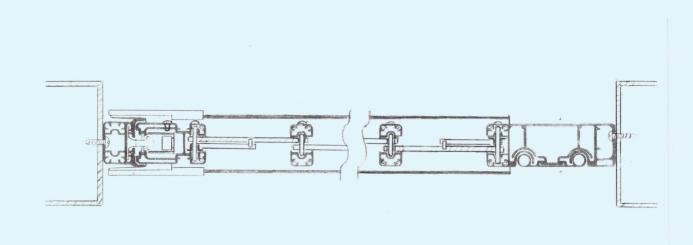










## **VERTICAL SECTION**

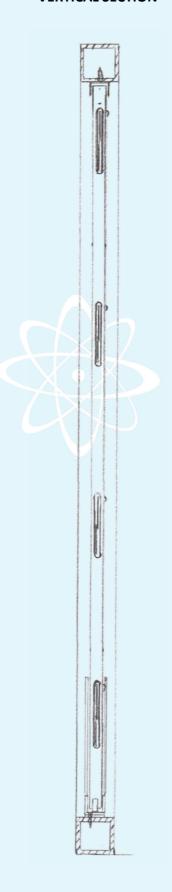








## **COMPONENTS**

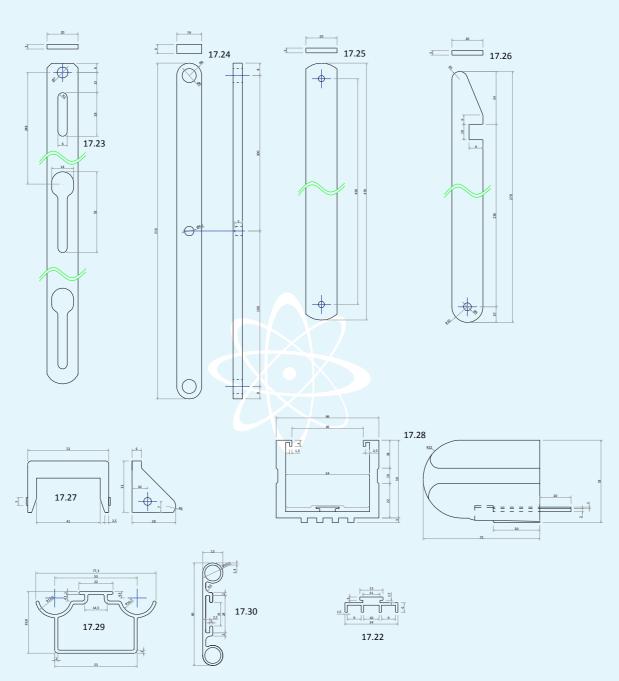












#### **PROFILES**

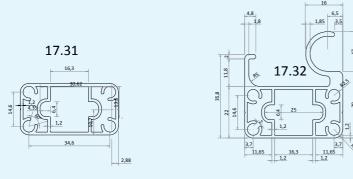









#### **Normative references**

The test was performed according to the requirements of the following standards:

- UNI EN 1627:2011 dated 16/06/2011 "Porte pedonali, finestre, facciate continue, inferriate e chiusure oscillanti Resistenza all'effrazione Requisiti e classificazione" (Pedestrian doorsets, windows, curtain walling, grilles and shutters Burglar resistance Requirements and classification);
- UNI EN 1628:2011 dated 16/06/2011 "Porte pedonali, finestre, facciate continue, inferriate e chiusure oscuranti Resistenza all'effrazione Metodo di prova per la determinazione della resistenza sotto carico statico" (Pedestrian doorsets, windows, curtain walling, grilles and shutters Burglar resistance Test method for the determination of resistance under static loading);
- UNI EN 1629:2011 dated 16/06/2011 "Porte pedonali, finestre, facciate continue, inferriate e chiusure oscuranti - Resistenza all'effrazione - Metodo di prova per la determinazione della resistenza sotto carico







dinamico" (Pedestrian doorsets, windows, curtain walling, grilles and shutters - Burglar resistance - Test method for the determination of resistance under dynamic loading);

UNI EN 1630:2011 dated 16/06/2011 "Porte pedonali, finestre, facciate continue, inferriate e chiusure oscuranti - Resistenza all'effrazione - Metodo di prova per la determinazione della resistenza all'azione manuale di effrazione" (Pedestrian doorsets, windows, curtain walling, grilles and shutters - Burglar resistance - Test method for the determination of resistance to manual burglary attempts).

#### **Test method**

The test was performed according to the requirements of the standards mentioned under the heading "Normative References" using detailed internal procedure PP009 review 12 dated 16/11/2011 "Porte, porte pedonali, finestre, facciate continue, inferriate e chiusure oscillanti - Resistenza all'effrazione: Metodi di prova e classificazione" (Doors, pedestrian doorsets, windows, curtain walling, grilles and shutters - Burglar resistance: Test methods and classification).

## Check and comparison of documentation provided and sample to be tested

In accordance with the requirements of standards UNI EN 1627:2011, UNI EN 1628:2011, UNI EN 1629:2011 and UNI EN 1630:2011 was checked the following documentation:

- description of the sample (type of product, characteristics of profiles, materials used and the thickness of the infill or glazing);
- mechanical properties of the materials;
- date of manufacture of the sample;
- declaration about classification of glazing;
- declaration about classification of the hardware;
- side of attack;
- drawings including tolerances and part list;
- installation instructions.

#### Static load in accordance with standard UNI EN 1628:2011

The test sample was subjected to a series of static loads for the resistance class 2.







The loads were applied through a pressing device, connected to a pneumatic piston, diameter 250 mm, controlled by motorized reducing valve able to apply the load with a predetermined gradient. The loads were detected by the use of a load cell, scale 25 000 N.

The deformation have been verified through a series of pass/fail templates conforming to paragraph A.10 of standard UNI EN 1628:2011.

The equipment used complies with the requirements of clause 4.8 "Tollerances" of standard UNI EN 1628:2011, therefore compliance with the class is set without regard to the banks by the uncertainty on the value of deformation, in line with paragraph 2.6 help ILAC G8: 03/2009 "Guidelines on the Reporting of Compliance with Specification".

#### Dynamic load in accordance with standard UNI EN 1629:2011

The test sample was subjected to a series of impacts to the resistance class 2 with element of impact of mass 50 kg according to the figure A.29 - Movable grilles: Impact points of standard UNI EN 1629:2011.

#### Manual burglar test in accordance with standard UNI EN 1630:2011

The test sample was subjected to a series of preliminary tests for resistance class 2 on the following areas:

- vertical bar;
- cross bar;
- rebate area, vertically, between sash and frame lock side;
- rebate area, vertically, back side between grill and frame.

For the preliminary tests were used set of tools "A1" and "A2".

Afterwards the sample was subjected to the final test for resistance class 2 with attack to the vertically bar, using the set of tools "A1" and "A2" used during the preliminary tests.

#### Test apparatus

The tests were carried out using the following equipment:

burglar resistance test rig (in-house identification code: EDI048) with a loading device (internal equipment identification code: FT481) connected to a load cell of 25 kN with calibration report issued by Istituto Giordano S.p.A.;







- series of load devices (in-house identification codes: EDI074a, EDI074b, EDI074c, EDI074d, EDI074e,
   EDI074f and EDI074g);
- series of calibrated templates (in-house identification codes: EDI075a, EDI075b, EDI075c and EDI075d);
- series of calibrated templates (in-house identification codes: EDI079a, EDI079b and EDI079c);
- mechanical device for the application of dynamic loads consisting of a special lifting system for adjusting the height completely electromechanical and mechanical system of the position of lateral translation and by impact element (in-house identification code: EDI012);
- metric bar (in-house identification code: FT364);
- digital caliper (in-house identification code: EDI066);
- stopwatch (in-house identification code: FT462);
- thermo-hygrometer (in-house identification code: FT231);
- digital video-camera;
- tools for manual attack test (in-house identification code: FT341), defined on the basis of expected class and shown in the table in the following sheets.

Quantity	Description	Tool no.
[n.]		
1	Multiple slip joint gripping pliers, maximum length 250 $\pm$ 10 mm	1.1
1	Screwdriver, total length 260 $\pm$ 20 mm, shaft diameter of 8 $\pm$ 2 mm and blade width 10 $\pm$ 1) mm	1.2
1	Set of small screwdrivers with different blade forms, shaft diameter maximum 6 $\pm$ 2 mm and total maximum length 250 mm	1.3
//	Hexagonal allen keys, maximum length 120 mm	1.4
//	Spanners, maximum length 180 mm	1.5
1	Engineer pliers, maximum length 200 mm	1.6
1	Tweezer	1.7
1	Knife, maximum length of blade 120 mm, thickness of blade maximum 3 mm	1.8
1	Torch	1.9
	Hooks	1.10
//	Steel wire	1.11
//	Adhesive tape	1.12
//	String	1.13
1	Rubber hammer, shore hardness 90 $\pm$ 10 shore, head weight 100 $\pm$ 20g, total weight 145 $\pm$ 20 g and length 260 $\pm$ 20 mm	1.14







Quantity	Description	Tool no.
[n.]		
1	Universal lock key	1.15
1	Screwdriver, length 365 $\pm$ 25 mm and blade width 16 $\pm$ 2 mm	2.1
1	Pipe wrench, length 240 ± 20 mm	2.2
2	Plastic wedges, length 200 $\pm$ 25 mm, width 80 $\pm$ 10 mm and height 40 $\pm$ 5 mm	2.3
2	Wood wedges, length 200 $\pm$ 25 mm, width 80 $\pm$ 10 mm and height 40 $\pm$ 5 mm	
1	Compass saw, 2 blades (bimetal or HSS metal cutting), length 310 $\pm$ 25 mm	2.5
1	Pad saw, 2 blades (bimetal or HSS metal cutting), dimensions $300 \times 13 \times 0,65 \text{ mm}$	2.6
1	Hacksaw, 2 blades (bimetal or HSS metal cutting), length 330 ± 25 mm	
1	Steel extension tube, length 500 mm, diameter 30 mm and maximum thickness 3 mm	2.8

## **Test team**

The team who carried out the final test was composed of the persons listed in the following table.

Function	Name	
Team Leader	Geom. Roberto Porta	
Timekeepers	Geom. Roberto Porta / Per. Ind. Alessandro Bonini	
Operatives	Per. Ind. Enrico Ugulini	
Video operator	Per. Ind. Alessandro Bonini	

# **Environmental conditions during test**

Atmospheric pressure	1013-1015 mbar
Ambient temperature	(25 ± 3) °C
Relative humidity	(45 ± 15) %







## **Test results**

## Checking of the documentation supplied and of the test sample

The results of the verifications of the documentation and sample, closed and locked in the closed condition, is shown in the following table.

Document to provide	Reference provided	Result
Sample description	document named "DESCRIPTION OF THE SAMPLE T120.doc"	compliant
Material properties	document named DESCRIPTION OF THE SAMPLE T120.doc" and "ADDITIONAL INFORMATION OF MECHANICAL PARTS - SAMPLE T120"	compliant
Date of production	provided	compliant
Glazing class	not supplied	not suitable
Hardware classification	for multipoint lock "ADDITIONAL INFOR- MATION OF MECHANICAL PARTS - SAMPLE T120"	compliant
	for the cylinder (EN 1303)	compliant <sup>*</sup>
	for cylinder protection (EN 1906)	compliant <sup>*</sup>
Side of the attack	shown on the sample and in the technical documentation	compliant
Construction drawings with dimensional tolerances	Drawings named "DETAILED PLANS LISTED T120.pdf"	compliant
Installation instructions	Documents named "THE MANUFACTUR- ER'S INSTRUCTIONS FOR INSTALLATION T120.doc" compliant	

<sup>(\*)</sup> not reachable from outside.







## Static load in accordance with standard UNI EN 1628:2011.


RC 2 product classifiable in group 4				
Loading point	Load device	Load	Used template	Result
		[kN]		
F1	5	3	D	compliant
F1.1	5	3	D	compliant
F2.1	5	1,5	D	compliant
F2.2	5	1,5	D	compliant
F2.3	1	1,5	D	compliant
F3A				compliant
F3B				compliant
F3C	2	3	D	compliant
F3D				compliant
F3E				compliant







# LAYOUT OF LOADING POINTS DURING STATIC LOAD TEST

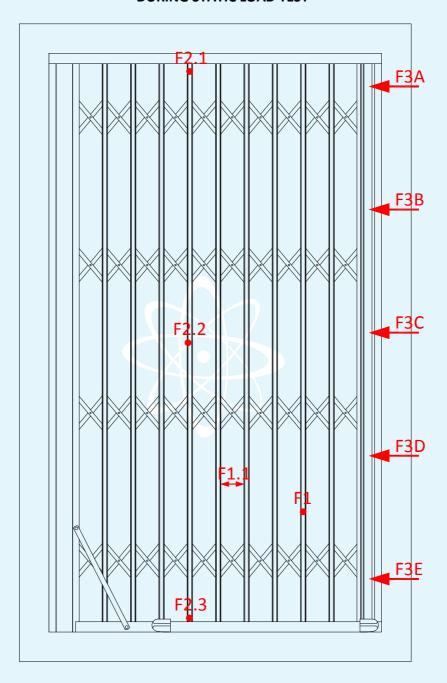







# Dynamic loading in accordance with standard UNI ENV 1629:2011

RC 2	
Result of test	the sample remains closed with evident deformations

## Manual burglary test (attack from outside) in accordance with standard UNI ENV 1630:2011

Preliminary tests - RC 2			
Test zone	Operative time	Used tools	Attack description
	[min:s]		
vertical bar	3:00	2.1, 2.2, 2.4	The operator using a couple of screwdrivers and a rubber hammer deforms and uncouple the connection between cross bars and vertical bars. At the end of the working time 3 connection are fully removed while 1 is very damaged but is still connected.
cross bar	3:00	2.1, 2.2, 2.4	The operator assaults the cross bar with the saw. In the working time he managed to cut 3 bars and remove only one and half cross connection. To open the grill is necessary to remove a minimum of 4 connections
rebate area, ver- tically, between sash and frame lock side	3:00	2.1, 2.2, 2.4	The operator using a couple of screwdriver and the rubber hammer attend to put the screwdriver between the fixed frame and the moveable parts of the grill. The particular conformation o of the connection does not allow this operation with class 2 tools
rebate area, ver- tically, back side between grill and frame	3:00	2.1, 2.2, 2.4	The operator using a couple of screwdriver and the rubber hammer attend to put the screwdriver between the fixed frame and the first fixed vertical bar of the grill. The particular conformation of the connection does not allow this operation with class 2 tools







Main test- RC 2				
Test zone	Operative time	Gross time	Used tools	Attack description
	[min:s]	[min:s]		
rebate area, ver- tically, between sash and frame lock side	3:00	6:20	2.1, 2.2, 2.4	The operator using a big screwdriver, the little screwdriver and a rubber hammer deforms and disengages the connection between cross bars and vertical bars. At the end of the working time are 3 connection fully removed while one is still connected but very damaged

#### Classification.

On the basis of the test performed, the results obtained and the provisions of standards UNI EN 1627:2011, UNI EN 1628:2011, UNI EN 1629:2011 and UNI EN 1630:2011, the test sample, comprising a single-leaf door, called "T 120 - 1350×2350" and submitted by the company VIOMETALOUMIN BOUTSINIS J. - BAFALOUKAS J. G.P. - Thesi Patima Aspropyrgos - 19300 ATHENS - Greece, has passed the tests prescribed therein. Therefore, in accordance with standard UNI EN 1627:2011, the sample belong to

RC 2\*

The results given refer exclusively to the test sample itself and are only valid under the same conditions in which testing was carried out.

This test report alone shall not be considered a certificate of conformity.

(\*) The classification was determined based on the measured values obtained experimentally, in line with paragraph 2.6 of the guide ILAC G8: 03/2009 "Guidelines on the reporting of compliance with specification".

Test Technician (Geom. Roberto Porta)

Head of Security and Safety Laboratory (Dott. Andrea Bruschi) Chief Executive Officer (Dott. Arch. Sara Lorenza Giordano)

Andrea Brusal au